

3500/92 Communication Gateway

Product Datasheet

Bently Nevada* Asset Condition Monitoring

Description

The 3500/92 Communication Gateway module provides extensive communication capabilities of all rack monitored values and statuses for integration with process control and other automation systems using both Ethernet TCP/IP and serial (RS232/RS422/RS485) communications capabilities. It also permits Ethernet communications with 3500 Rack Configuration Software and Data Acquisition Software.

Supported protocols include:

- Modicon® Modbus® protocol (via serial communications)
- Modbus/TCP protocol (a variant of serial Modbus used for TCP/IP Ethernet communications)
- Proprietary Bently Nevada protocol (for communication with 3500 Rack Configuration and Data Acquisition Software packages)

The Ethernet connection to the 3500/92 is an RJ45 connection for 10BASE-T star configuration Ethernet networks.

The 3500/92 supports the communication interfaces, communication protocols, and other features from the original 3500/90 with the exception of the primary value Modbus registers. The 3500/92 now has a Configurable Modbus Register Utility, which can provide the same functionality originally addressed by the primary value Modbus registers.



Specifications

Inputs

Power Consumption	5.0 watts typical with ModbusRS232/ RS422 I/O Module 5.6 watts typical with Modbus RS485 I/O Module
Data Types:	Collects data from other modules in the rack, such as current proportional values with time stamp, module statuses, and current alarm statuses, via a high speed internal network. Exact data types returned depend on module type and channel configuration. Update Time: The data collection rate depends on rack configuration but will not exceed 1 second for all modules in the 3500 rack.

Outputs

OK LED:	Indicates when the 3500/92 is operating properly.
TX/RX LED:	Indicates when the 3500/92 is communicating with other modules in the 3500 rack.

Protocols

BNC Host Protocol:	Communication with 3500 Configuration Software and 3500 Data Acquisition and Display Software over Ethernet TCP/IP.
Modbus®:	Based on AEG Modicon PI-MBUS-300 Reference Manual. Uses Remote Terminal Unit (RTU) transmission mode. Modbus is a registered trademark of Modicon, Inc.
Ethernet	
Communication Link:	Ethernet, 10Mbps, and conforms to IEEE802.3
Protocol:	Ethernet TCP/IP frame and Modbus/TCP
Connection:	RJ-45 (telephone jack style) for 10BASE-T Ethernet cabling

Environmental Limits

Main and I/O Module	
Operating Temperature:	-30 °C to +65 °C (-22 °F to +149 °F)
Storage Temperature:	-40 °C to +85 °C (-40 °F to +185 °F)
Humidity:	95%, non-condensing

Physical

Main Board	
Dimensions (Height x Width x Depth):	241 mm x 24.4 mm x 242 mm (9.50 in x 0.96 in x 9.52 in)
Weight:	0.82 kg (1.8 lb.)
I/O Modules	
Dimensions (Height x Width x Depth):	241 mm x 24.4 mm x 99.1 mm (9.50 in x 0.96 in x 3.90 in)
Weight:	0.44 kg (0.96 lb.)

Rack Space Requirements

Monitor Module:	1 full-height front slot
I/O Modules:	1 full-height rear slot

Compliance and Certifications



Note: This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) This device must accept any interference received, including interference that may cause undesired operation.

EMC	EN 61000-6-2 Immunity for Industrial Environments EN 61000-6-4 Emissions for Industrial Environments EMC Directive 2014/30/EU
Electrical Safety	EN 61010-1 LV Directive 2014/35/EU
RoHS	RoHS Directive 2011/65/EU
ATEX (with applicable ordering dash option)	ATEX directive 2014/34/EU

Hazardous Area Approvals



For the detailed listing of country and product specific approvals, refer to the **Approvals Quick Reference Guide**, document 108M1756, at www.GEmeasurement.com.

CSA/NRTL/C (Approval Option 01)	
When used with I/O module ordering options with internal barriers:	Ex nC [ia] IIC T4 Gc Class I, Division 1, Groups A, B, C, and D Class 1, Zone 2/0 AEx nC [ia] IIC T4 Gc Class 1, Division 1, Groups A, B, C, and D T4 @ Ta = -20 °C ≤ Ta ≤ +65 °C (-4 °F ≤ Ta ≤ +149 °F) per drawing 138547
When used with I/O module ordering options without internal barriers:	Ex nC [L] IIC T4 Gc Class I, Division 2, Groups A, B, C, and D Class 1, Zone 2 AEx nC IIC T4 Gc Class 1, Division 2, Groups A, B, C, and D T4 @ Ta = -20 °C ≤ Ta ≤ +65 °C (-4 °F ≤ Ta ≤ +149 °F) per drawing 149243

ATEX/IECEx (Approval Option 02)	
For ATEX agency approval ordering options with internal barriers:	 II 3 (1) G Ex nA nC ic [ia Ga] IIC T4 Gc T4 @ Ta = -20 °C ≤ Ta ≤ +65 °C (-4 °F ≤ Ta ≤ +149 °F)
For ATEX agency approval ordering options without internal barriers:	 II 3 G Ex nA nC ic IIC T4 Gc T4 @ Ta = -20 °C ≤ Ta ≤ +65 °C (-4 °F ≤ Ta ≤ +149 °F)

Ordering Options

The 3500/92 Communication Gateway

3500/92-AXX-BXX-CXX

A: I/O Module Type

- 01** ModbusRS232/RS422 I/O Module
- 02** ModbusRS485 I/O Module
- 03** Ethernet/RS232 Modbus I/O Module
- 04** Ethernet/RS485 Modbus I/O Module

B: Memory Type

- 01** Low Memory

C: Agency Approval Option

- 00** None
- 01** CSA/NRTL/C
- 02** CSA/ATEX/IECEX

Additional Options

Firmware	
126M4118-01	Firmware Upgrade Kit NOTE: Older Communication Gateway modules will require a Firmware Upgrade to communication with a new I/O Module. See 3500/92 manual for detailed information.
Spares	
04425545	Grounding Wrist Strap (single use)
137495-01	Firmware IC (Odd bank)
137494-01	Firmware IC (Even bank)
136180-01	3500/92 Communication Gateway Module.
125736-01	ModbusRS232/RS422 I/O Module.
133323-01	ModbusRS485 I/O Module.
136188-01	Ethernet/RS232 Modbus I/O Module ₁
136188-02	Ethernet/RS485 Modbus I/O Module ₁
Documentation	
Bently_Manuals	International Technical Documentation DVD

Accessories

139036-01	9-pin D-SUB "Y"
Serial Converters	
02230411	RS232 to RS422 Converter - 110 Vac.
02230412	RS232 to RS422 Converter - 220 Vac.
Ethernet Hubs	

142808-00	16-port unmanaged 10BASE-T hub w/ no backbone connection
142808-01	16-port unmanaged 10BASE-T hub w/ 10BASE-2 (Thinnet) backbone
142808-02	16-port unmanaged 10BASE-T hub w/ Fiber-optic, ST connection backbone
142808-03	16-port unmanaged 10BASE-T hub w/ 15-pin AUI backbone
142809-00	6-port unmanaged 10BASE-FL hub w/ no backbone connection
142809-01	6-port unmanaged 10BASE-FL hub w/ 10BASE-2 (Thinnet) backbone
Ethernet Transceivers	
02200260	15-Pin AUI male to Fiber Optic Cable (10BASE-FL) with ST connection
02200261	15-Pin AUI male to Thinnet (10BASE2)
Ethernet Cabling - Standard 10 BASE-T Shielded Category 5 Cable with RJ-45 connectors	
02175190	6 ft. Length
02175191	10 ft. Length
02175192	25 ft. Length

Standard 10BASE-T Shielded Category 5 Cable with RJ-45 connectors

138131-AXXX

A: Length (in ft.) up to 320 ft in length.

- 0 0 6** 6 feet (1.8 meters)
- 0 1 0** 10 feet (3 meters)
- 0 2 5** 25 feet (7.3 meters)
- 0 4 0** 40 feet (12 meters)
- 0 5 0** 50 feet (15 meters)
- 0 7 5** 75 feet (22.5 meters)
- 0 8 5** 85 feet (25.5 meters)
- 1 0 0** 100 feet (30.5 meters)
- 1 2 0** 120 feet (36.6 meters)
- 1 5 0** 150 feet (44.8 meters)
- 2 0 0** 200 feet (61 meters)
- 2 5 0** 250 feet (75 meters)
- 3 2 0** 320 feet (98 meters)

For specific cable lengths, order through Custom Products.

- 30 ft. - 100 ft. in 5ft. increments only
- 100ft. - 320 ft. in 10ft. increments only

¹ These spares include the Firmware Upgrade Kit (126M4118-01).

Serial Cabling (RS232): RS232 Cable, Host to 3500/92

130419-AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

RS232 Cable, Honeywell PLCG to 3500/92

130420 - AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

130119-01 RS232 Cable, Host Computer to RS232/RS422 Converter

Serial Cabling (RS422/RS485):

RS422 Cables can be used for rack-to-rack connections when using ModbusRS485 I/O Modules. The final rack-to-host connection is application specific and may require a custom cable.

RS422 PVC Insulated Cable, RS232/RS422 Converter to 3500/92

130530 - AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)
- 0 2 5 0** 250 feet (75 meters)
- 0 5 0 0** 500 feet (150 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

RS422 PVC Insulated Cable, 3500/92 to 3500/92

129665-AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)
- 0 2 5 0** 250 feet (75 meters)
- 0 5 0 0** 500 feet (150 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

RS422 Teflon Insulated Cable, RS232/RS422 Converter to 3500/92

131109 - AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)
- 0 2 5 0** 250 feet (75 meters)
- 0 5 0 0** 500 feet (150 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

131108 - AXXXX-BXX

A: Cable Length

- 0 0 1 0** 10 feet (3 meters)
- 0 0 2 5** 25 feet (7.5 meters)
- 0 0 5 0** 50 feet (15 meters)
- 0 1 0 0** 100 feet (30.5 meters)
- 0 2 5 0** 250 feet (75 meters)
- 0 5 0 0** 500 feet (150 meters)

B: Assembly Instructions

- 0 1** Not Assembled
- 0 2** Assembled

RS422/RS485 Extension Cable

130531 - AXX - BXX

Used with Cables 130530, 129665, 131109, and 131108 for lengths greater than 500 feet (152 meters).

Standard length is 500 feet (152 meters).

A: Assembly Instructions

0 1 Not Assembled

0 2 Assembled

B: Insulation


0 1 PVC Insulated

0 2 Teflon® Insulated



Note: The total RS485 cable run can be up to 4000 feet (1220 meters). The total RS422 cable run can be up to 4000 feet (1220 meters) between each rack

Graphs and Figures

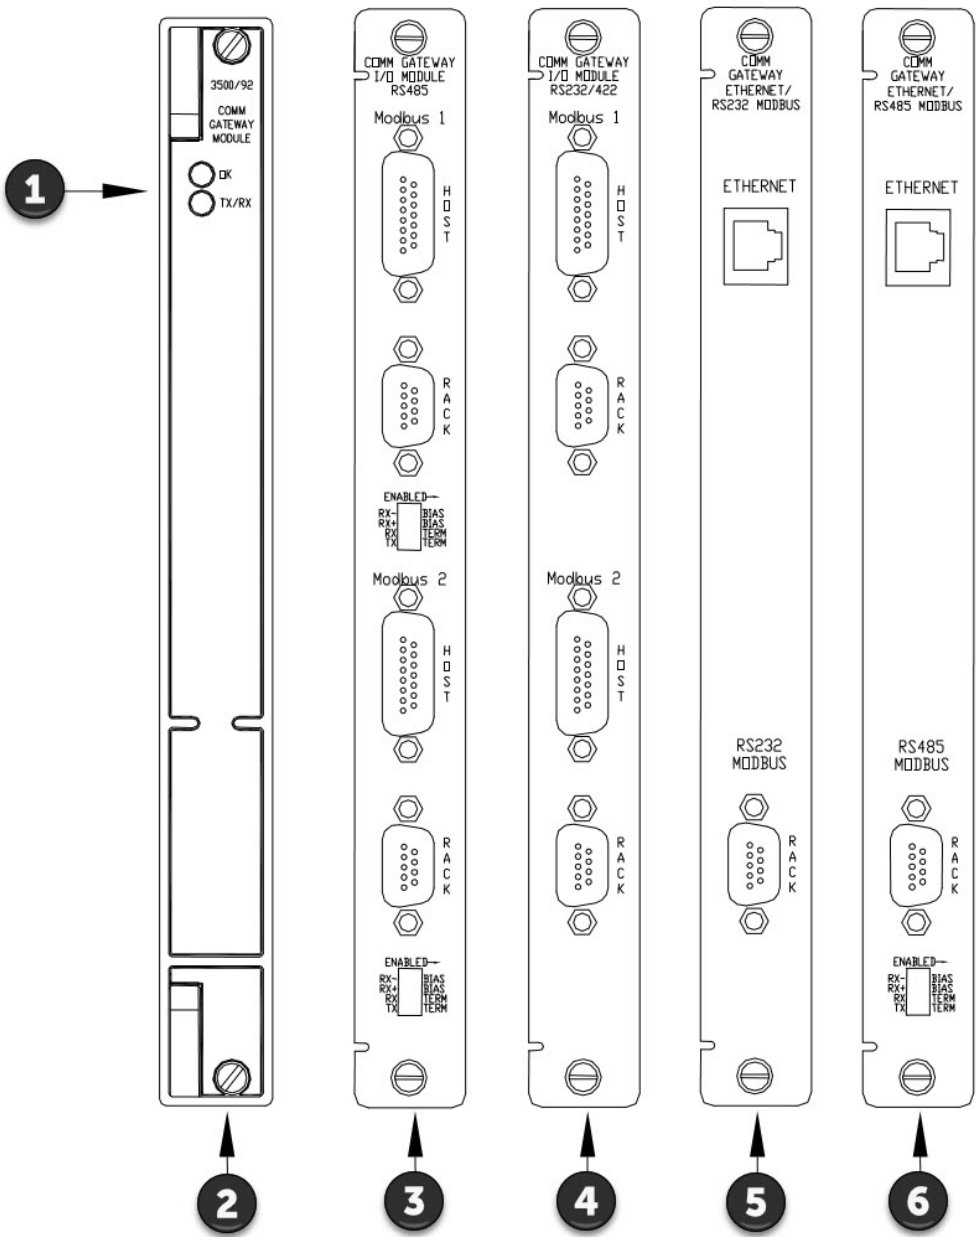

- 1: Status LEDs
- 2: Comm Gateway Module
- 3: RS485 I/O Module
- 4: RS232/422 I/O Module
- 5: Ethernet/RS232 I/O Module
- 6: Ethernet/RS485 I/O Module

Figure 1: Front and rear views of the Communication Gateway

Copyright 2004 - 2018 Baker Hughes, a GE company, LLC ("BHGE") All rights reserved.

* Denotes a trademark of Bently Nevada, LLC, a wholly owned subsidiary of Baker Hughes, a GE company .

All product and company names are trademarks of their respective holders.

Use of the trademarks does not imply any affiliation with or endorsement by the respective holders.

The information contained in this document is subject to change without prior notice.

1631 Bently Parkway South, Minden, Nevada USA 89423

Phone: 1-775.782.3611 www.GEmeasurement.com